

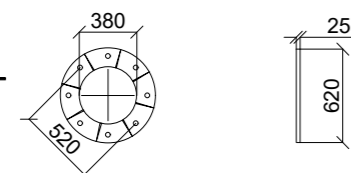
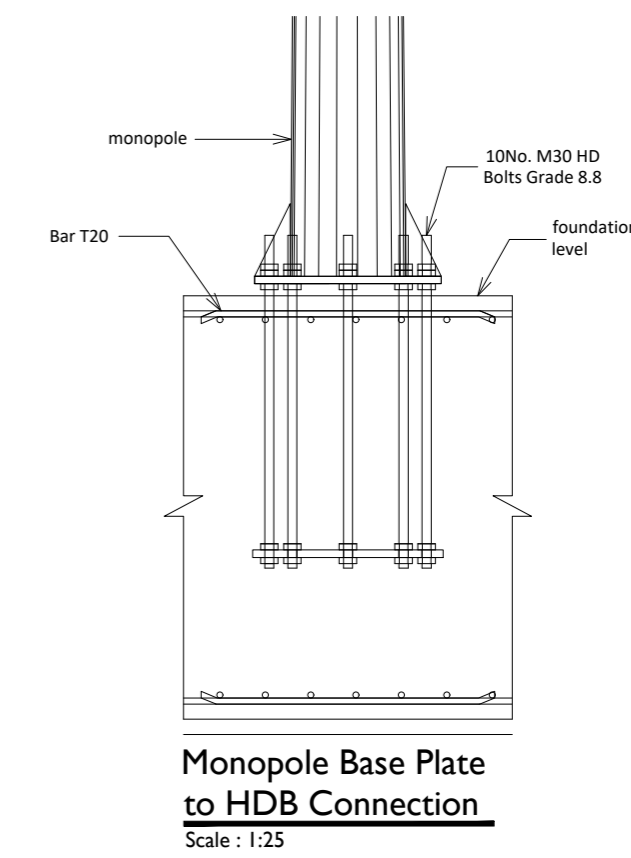


**Monopole Details**  
Scale : 1:50

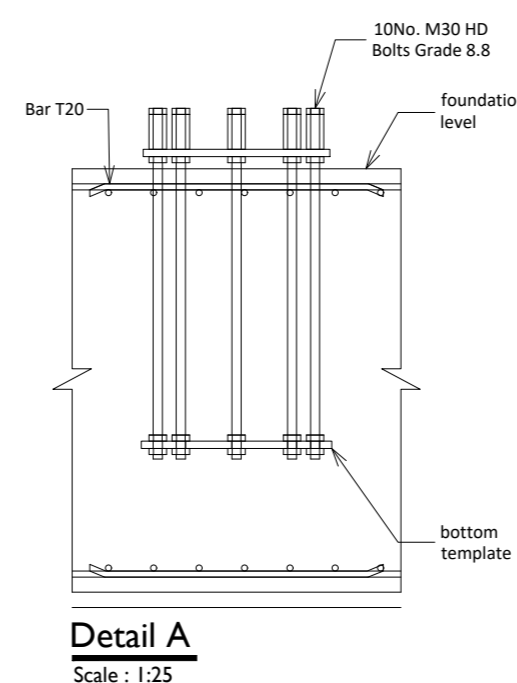

**Foundation Details**

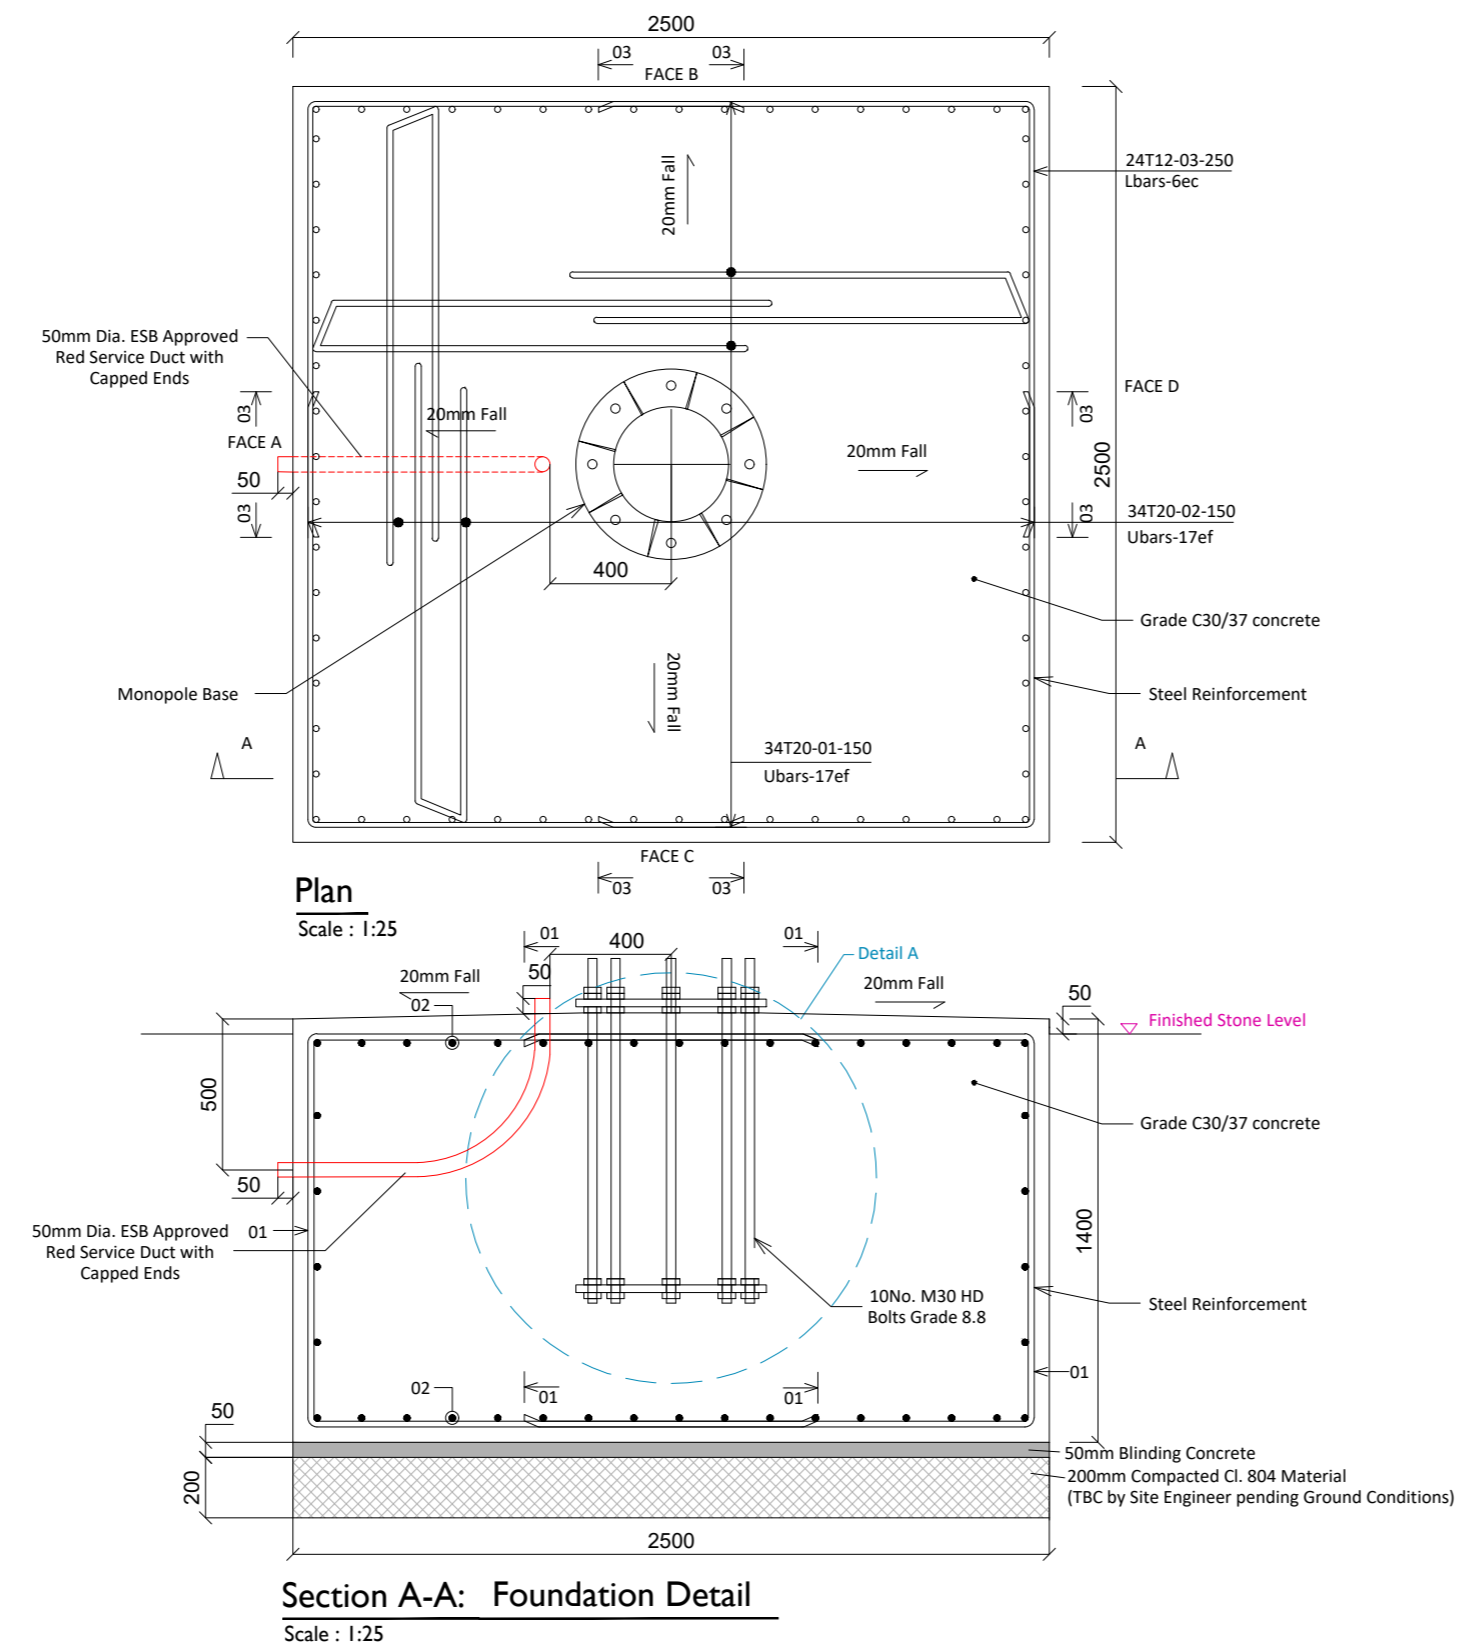

**GENERAL NOTES:**

1. ALL DRAWINGS TO BE READ IN CONJUNCTION WITH THE SPECIFICATION AND ALL ENGINEERS AND ARCHITECTS DRAWINGS
2. ALL CONCRETE TO BE IN ACCORDANCE WITH I.S. EN 206-1:2002 WITH THE MIX DESIGNS SHOWN IN TABLE 1
3. CONCRETE FINISHES TO BE IN ACCORDANCE WITH TABLE 6.1 OF THE ESB SPECIFICATION CS17-S01-005.
4. ALL REINFORCEMENT SHALL BE IN ACCORDANCE WITH BS4449 AND SCHEDULED IN ACCORDANCE WITH BS.8666. 300MM LAPS FOR A142 MESH 600MM MIN LAPS FOR A393 MESH.
5. REFER ALWAYS TO RELEVANT EARTH GRID DRAWING PRIOR TO EXCAVATIONS & CONCRETE POURS
6. GEOMETRICAL TOLERANCES TO BE IN ACCORDANCE WITH TABLE 6.2 OF ESB SPECIFICATION CS17-S01-005

**FOUNDATION NOTES:**

7. GROUND TO HAVE A MINIMUM BEARING CAPACITY OF 100 kN/M<sup>2</sup>.
8. FORMATION LEVEL AND FOUNDATIONS TO BE INSPECTED AND APPROVED BY THE ENGINEER PRIOR TO ANY CONCRETE BEING POURED.
9. ALL FOUNDATIONS ARE TO BE BLINDED IMMEDIATELY AFTER EXCAVATION WITH 50MM OF C16/20 CONCRETE BLINDING.
10. REFER ALWAYS TO THE RELEVANT EARTH WORK DRAWINGS PRIOR TO EXCAVATIONS & CONCRETE POURS.



Head Office  
Beenreigh, Abbeydorney,  
Tralee, Co. Kerry, Ireland  
Tel: 00353 66 7135710

**PROJECT**

**Clogherchor Wind Farm  
110kV Grid Connection**

**CLIENT**



**CONSULTANTS**



**NOTES: -**

- This drawing is to be read in conjunction with relevant engineering drawings, specifications and reports
- Dimensions are in millimeters, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only

**LEGEND: -**

**ISSUE/REVISION**

I/R	DATE	DESCRIPTION
P01	11.01.23	Issued for Information
P00	03.10.22	Issued for Information

**PROJECT NUMBER**

05-725

**SHEET TITLE**

Lightning Monopole Foundation  
Details-18m Masts

**SHEET NUMBER**

05725-DR-116