

Scale 1:500



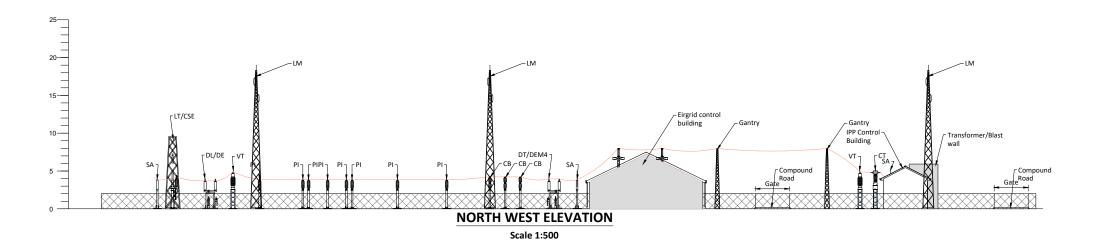

if Applicable : Ordnance Survey Ireland Licence No. EN 0001220 © Ordnance Survey Ireland and Government of Ireland

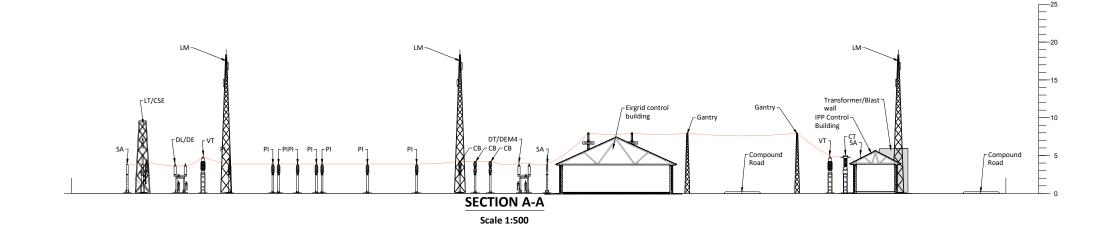

Rev.	Description	Арр Ву	Date
Α	ISSUE FOR COMMENT	JH	23.12.19

]	PROJECT	CLIENT					
	COOM GREEN ENERGY PARK		CROOM GREEN ENERGY PARK LIMITED				
11	SHEET DOOR OF DELINION CONTROLLED AT	Date	23.12.19	Project number P20-099	Scale (@ A3-) 1:500		
1	PROPOSED SUBSTATION COMPOUND AT MULLENABOREE - ELEVATION & SECTIONS	Drawn by	soc	Drawing Number		Rev	
		Checked by	ТВ	P20-099-0300-0002		Α	

Legend LIGHTING MAST SURGE ARRESTER VOLTAGE TRANSFORMER CURRENT TRANSFORMER, SINGLE PHASE POST INSULATOR LINE TRAP (TYPICALLY R & T PHASES) DL/DE LINE/EARTH DISCONNECT TRAFO/EARTH DISCONNECT СВ CIRCUIT BRAKER BUSBAR DISCONNECT SECTIONALISER DISCONNECT SB1/SB2



New Loop Station

Note 1: This is a conceptual design for guidance only. All dimensions and references given are indicative only. Layout to be further optimised during detail design pending specific equipment supplier and site details.

Note 2: Additional post insulators may be required, subject to detail design. Not shown for clarity.

Note 3: Vehicular access to all HV plant shall be permitted without the need for unnecessary proximity outages. Consideration of LV cable trench layouts and traffic-able trench covers shall be considered during detailed design.

Lightning mast, LV trench duct routes, marshalling/interface cabinets and lighting fixtures shall be considered during detail

Note 5 (as illustrated on drawing):
The low level T & S phase bay conductors are arranged closer together to avoid unnecessary proximity outages on adjacent bays. To be repeated for all bays.

Note 6 (as illustrated on drawing): Independent supported span on low level bay conductors between DA and DB. The connection at the PI should be able to be broken to allow the link between DA and DB to be

Note 7 (as illustrated on drawing):
Distance between CT and CB on wing coupler to be a minir
of 6500mm from the busbar side of the open disconnect.
Distance between disconnect and adjacent low level bat
conductor to be a minimum of 6500mm.

Note 8 (as illustrated on drawing): 6500mm distance required between busbar and CB on each

Note 9 (as illustrated on drawing): Diesel generator and station rural feeding arrangement shall be in line with Eirgrid station auxiliary power supplies specification.

